
Manitowoc Parts & Service Communicator

Subject: Indigo QuietQube Ice Machines and ICVD Condensing Unit Interconnecting Wiring

Indigo QuietQube ice machines require interconnecting low voltage wiring (included with Manitowoc line sets) to energize the contactor coil and verify the LPCO & HPCO are closed. This circuit also initiates a time delay whenever the LPCO or HPCO open. Failure to properly wire the ICVD condensing unit or ice machine head section will result in a non-operational machine. Refer to the Indigo Technicians Handbook for normal operation and diagnostics for the HPCO & LPCO controls.

Wire Specifications:

- 18 AWG - 5 Conductor, Single Strand
- Plenum Smoke Rating
- UL rated to 300 Volts

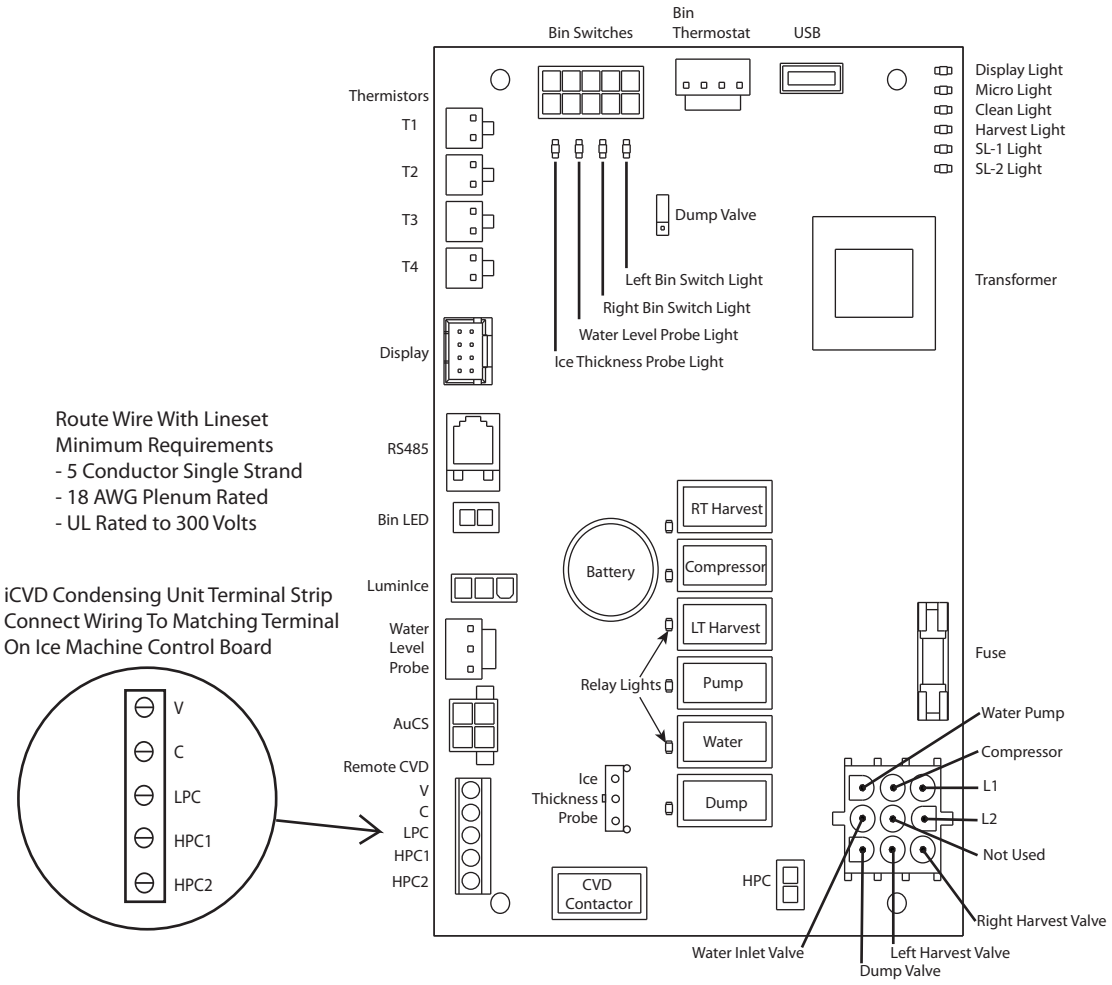

MANITOWOC ICE

Address - 2110 S. 26th St., P.O. Box 1720, Manitowoc, WI 54221-1720 USA
Telephone - 920-682-0161 • Service Fax - 920-683-7585 • Web Site - www.manitowocice.com